


PLAN - 76th FL. - SS - 75W

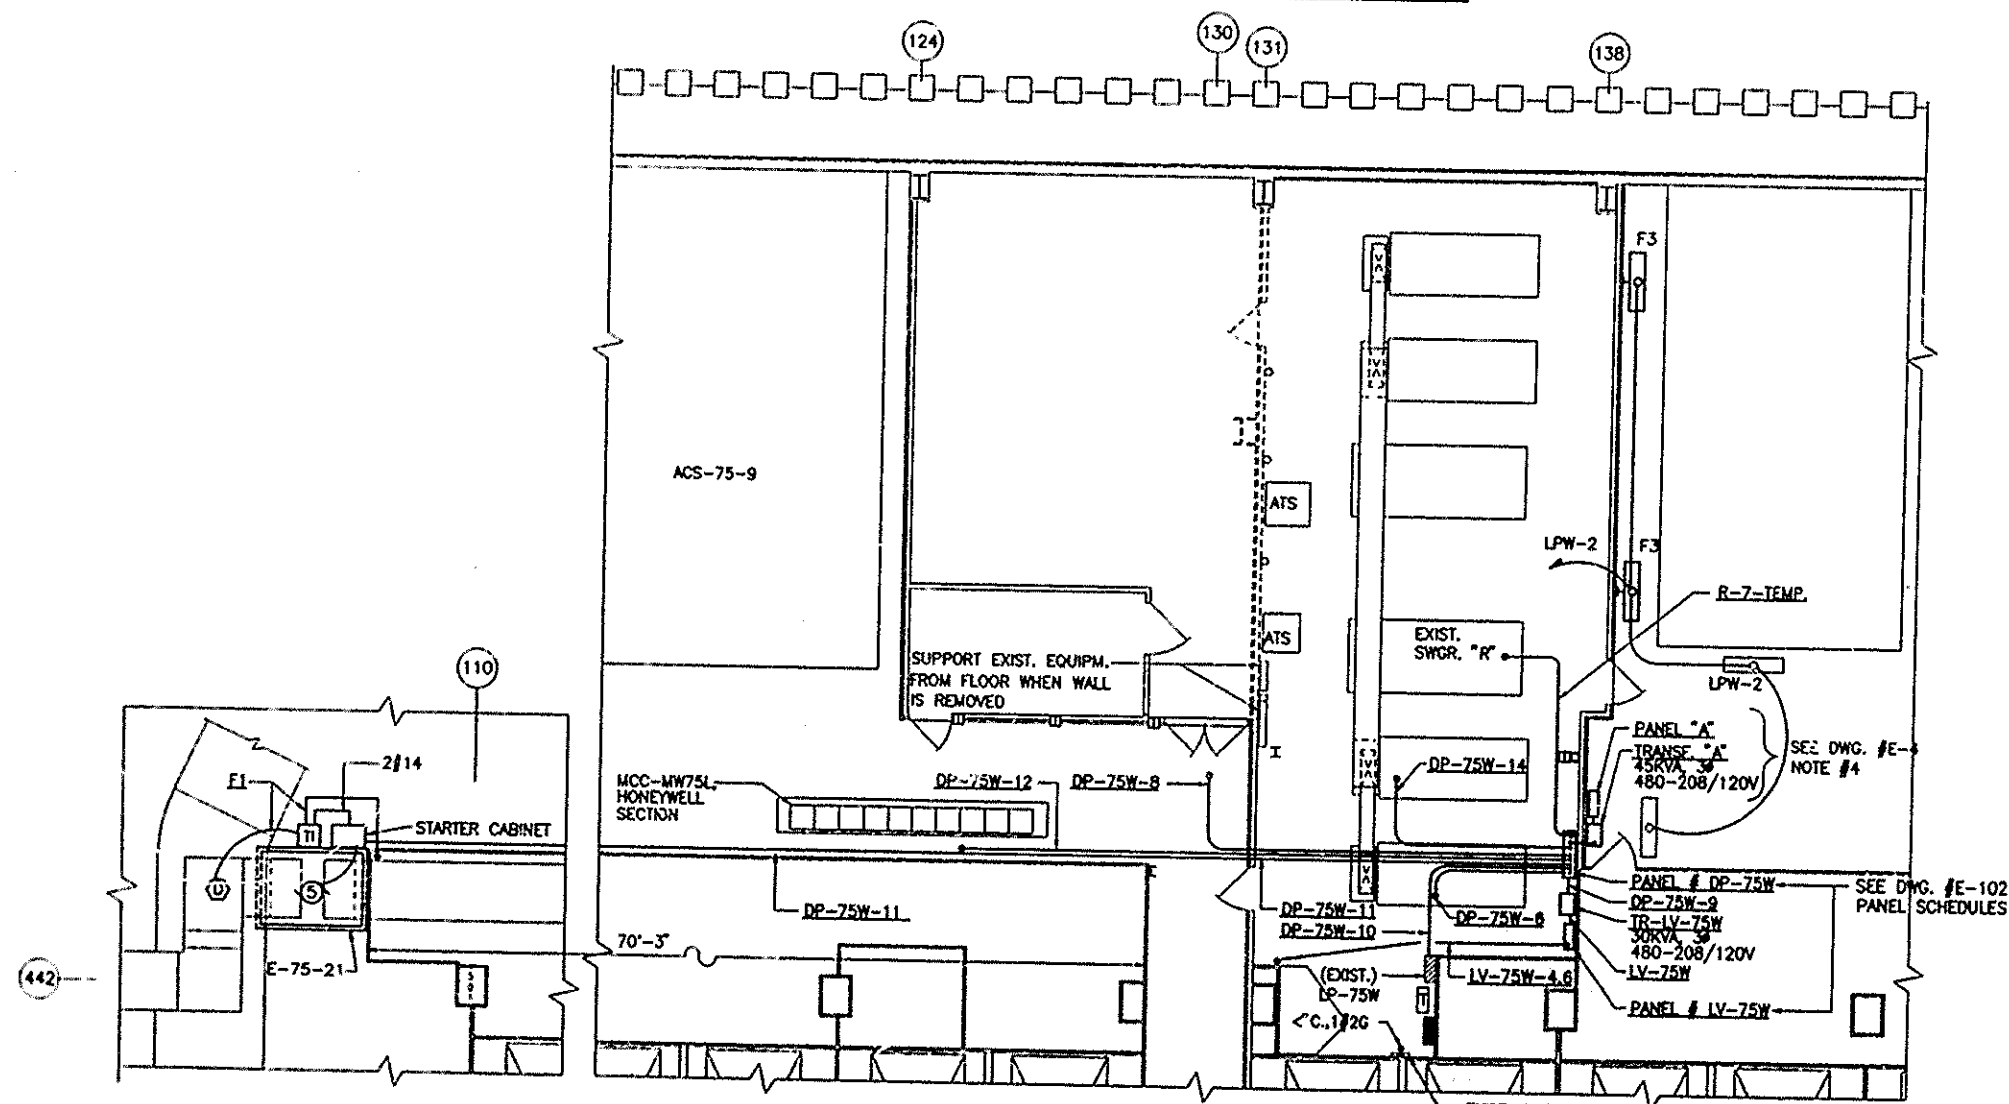

PLAN - 75th FL. - SS - 75W

NOTES

1. FOR LEGEND SEE DWG. #E-1, FOR GENERAL NOTES, ABBREVIATIONS AND LIGHTING FIXTURE SCHEDULE SEE DWG. #E-2.
2. FOR TYPICAL SUBSTATION STAGE I SEQUENCE OF INSTALLATION SEE DWG. #E-4.

Sheet 153 of 224

THE PORT AUTHORITY
OF NY & NJ

Peter K. Sweeney
ENGINEERING PROGRAM MANAGER
WORLD TRADE CENTER
Chief ELECTRICAL ENGINEER

Engineering Department
Design Divisions

The World Trade
Center
Electrical/HVAC
Upgrade Program

Title
TOWER ONE AND TWO
LOW VOLTAGE
SUBSTATIONS
CONSTRUCTION AND
INSTALLATION

ELECTRICAL

SUBSTATION SS-75W
STAGE I
INSTALLATION PLANS

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT
COPY OF ONE OF THE CONTRACT DRAWINGS CON-
STITUTING A PART OF CONTRACT NO. WTC-802.071
IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT
THE TIME THE SAID CONTRACT WAS EXECUTED BY
THE PARTIES.

DATE 6/21/95 Sultan A. Aslam
SPEC. WRITER

DATE 8/15/95 Peter K. Sweeney
ENGINEER OF DESIGN

N
0 4 8 12 16
SCALE IN FEET

No. Date Revision Approved

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

ROYZMAN
FISCHER
Designed by
ROYZMAN
Drawn by
A.S.
Checked by

Date 5-1-95 Scale AS NOTED

Contract Number
WTC 802.071
Drawing Number
E-67